


REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

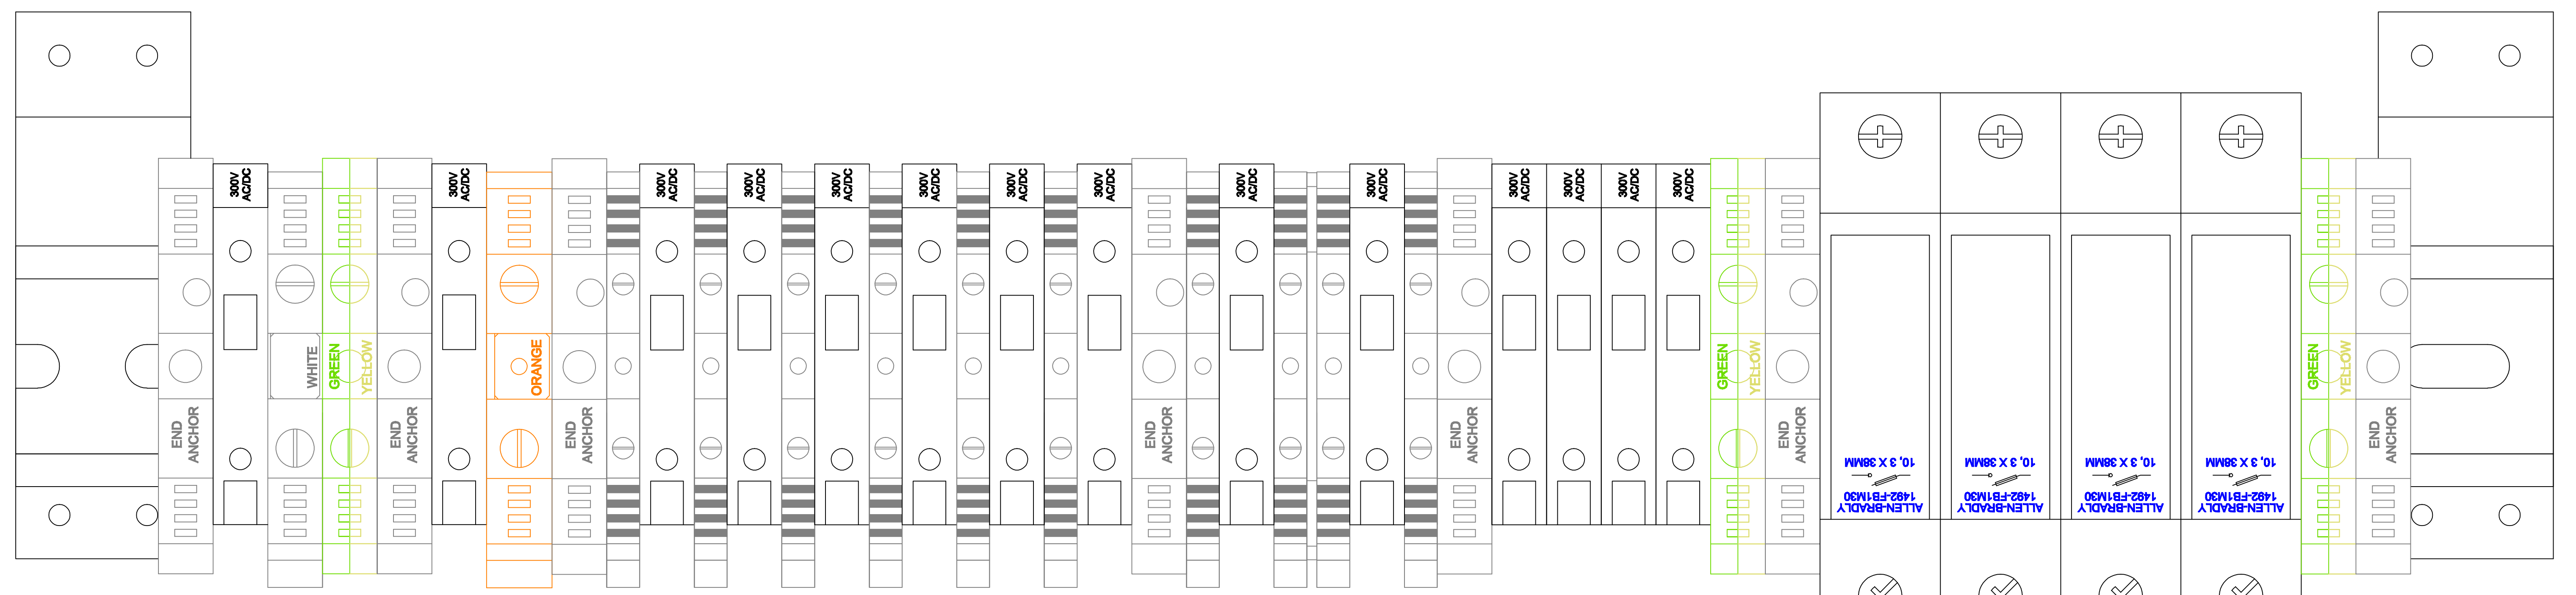


- | | | |
|-----------------------------|------------------|------------------|
| 120V AC Power- (2A) Line- | 485B Bro- (1/2A) | 485B Bro- (1/2A) |
| Neutral- | 24V Red- (2A) | 24V Red- (2A) |
| Ground- | Com Org- (10A) | Com Org- (10A) |
| (2A) +24VDC- | 485A Yel- (1/2A) | 485A Yel- (1/2A) |
| -24VDC- | Shield- | Shield- |
| NC Contact- (5A) Gas Valve- | | |
| NC Contact- (5A) Gas Pump- | | |
| NO Contact- (5A) Egh Fan- | | |
| NO Contact- (5A) Rem Alarm- | | |
| NC Contact- (5A) Equipment- | | |
| NC Contact- (5A) Trouble- | | |
| NO Contact- (5A) Common- | | |
| NC Contact- (5A) Common- | | |
| NO Contact- (5A) Common- | | |
| NC Contact- (5A) Common- | | |

DRAWING 3 OF 4
AUSID09
PLC-NY TERMINAL DIAGRAM

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION WHICH SHALL NOT BE REPRODUCED, TRANSFERRED TO OTHER DOCUMENTS, DISCLOSED TO ANY THIRD PARTY, OR USED FOR MANUFACTURING OR ANY OTHER PURPOSE WITHOUT THE EXPRESS WRITTEN APPROVAL OF CONSPEC CONTROLS INC.

NAME	DATE
CKD:	00/00/00
DWN:	BAB 9/7/17
REV:	



CONSPEC
 6 Guttman Blvd.
 Charleroi, PA 15022
 conspec-controls.com

SIZE	FSCM NO.	DWG NO.	REV
D		AUSID09	A
SCALE	NTS		SHEET

AUSID09.dwg